


1520-C-101/B ON 1520-C-101/A

SCHEDULE OF DOOR

TYPE	OPENING SIZE W D X H	DESCRIPTION	NO. REQD.	REF. DRG. NO.
SDC	600 X 2100	SINGLE LEAF STEELW. 2	1520-C-44	

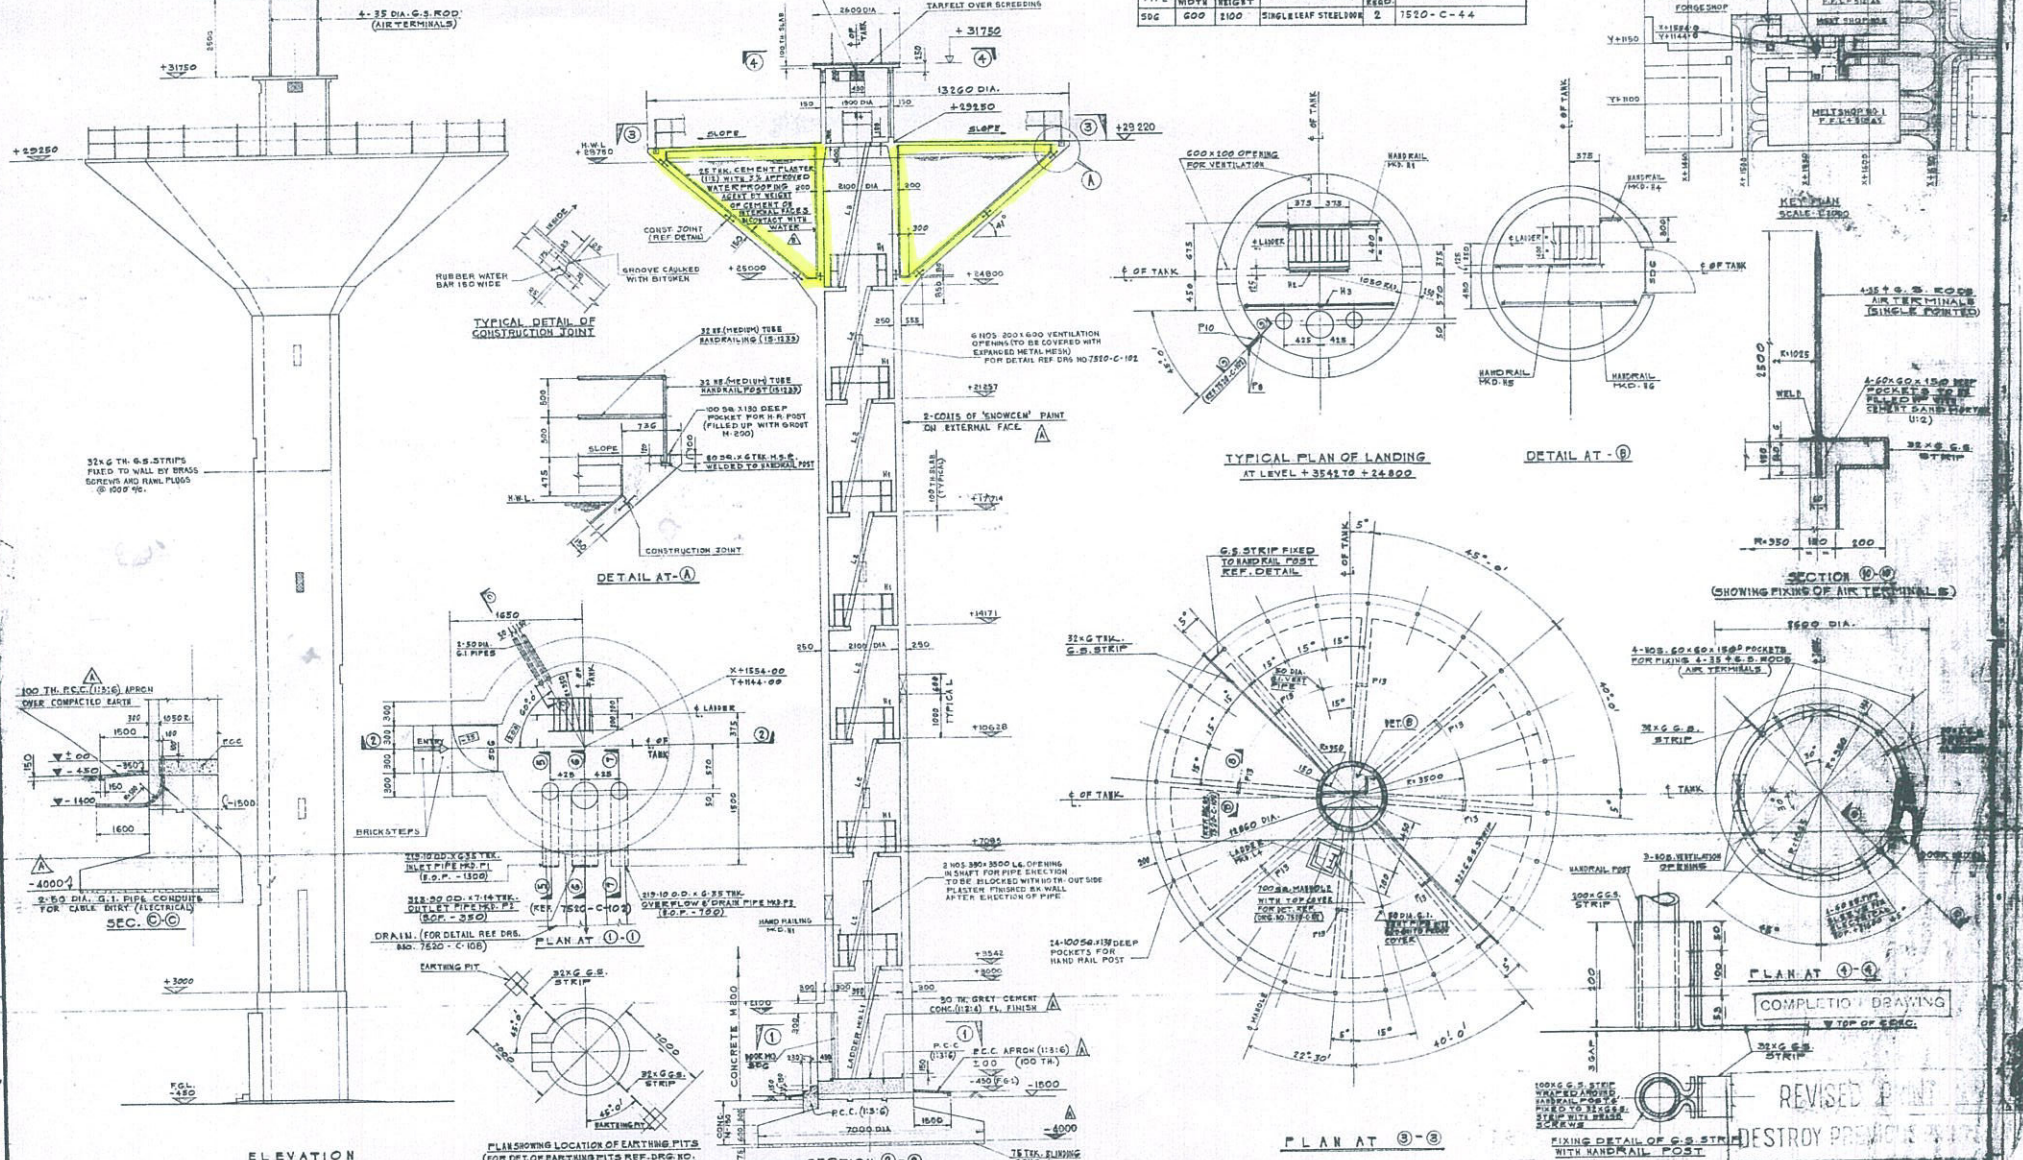

- ALL DIMENSIONS AND LEVELS ARE IN MILLIMETERS UNLESS OTHERWISE STATED.
- 200 LEVEL COVERED PIPES TO BE IN PLACE.
- DIME BELL SHAPED RUBBER WATER BARS TO BE PROVIDED AT ALL CONSTRUCTION JOINTS IN TANK WALLS.
- CRAG GRAPHS TO BE PROVIDED FOR VENTILATION IN TANK FOR SHARP AND TANK AS SHOWN IN SECTION.
- ALL INSERTS AND EMBEDDED PIPES TO BE PROVIDED WITH PROPER FINISHES TO BE PROVIDED BY CIVIL CONTRACTOR.
- FOR LOCATION OF OTHER INSERTS, EMBEDDED STEEL ETC. REF. DRG. NO. 1520-C-102.
- SAFE BREAKING PRESSURE OF SOIL ASSUMED TO BE 20 T/M<sup>2</sup>.
- ELECTRICAL EMBEDDED CONDUITS TO BE PROVIDED WITH S.C.L. PULL WIRE.
- FOR TANKS AND HANDRAIL CONNECTIONS TO BE WELDED OR JOINED WITH E.L.E.W. TEES & CROSS TEES TO BE AT SITE.
- 32x6 G.S. STRIPS SHALL BE PROPERLY BOLTED OR WELDED AT JOINTS FOR ELECTRICAL.

APPROVAL		CONSULTING ENGINEERS		FOR	
BY	DATE	M. N. DASTUR & COMPANY (P) LIMITED		MISHRA DHATU NIGAM LIMITED	
BY	DATE	SCALE: 1/25, 30/30		DATE	
BY	DATE	DRAWN BY		DATE	
BY	DATE	CHKD BY		DATE	
BY	DATE	APPRD BY		DATE	

REVISIONS

NO.	DATE	ZONE	REVISION	REMARKS	BY	APP.	DRG. No.	DETAILS
1	27.7.73		REVISED AS NOTED					
2	28.7.73		TANK LEVEL REVISED & TO BE MARKED					

NOTES

This drawing is the property of M. N. Dastur & Company (P) Limited and not to be copied or used without their permission.

JOB No 7500 DRG. No. 1520-C-101

FOR MODULE - II (OHT)